


## **UNOBSTRUCTED ACCESS ROADWAY**

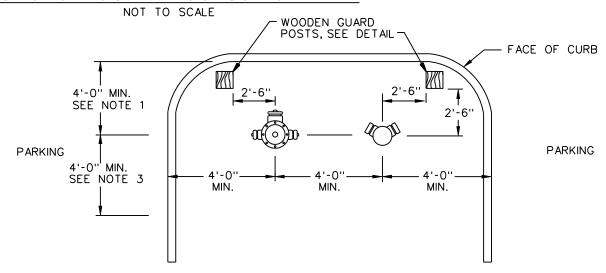

## **UNOBSTRUCTED ACCESS ROADWAY**

NOTES:

NOT TO SCALE

- GUARD POSTS ARE REQUIRED IF HYDRANT AND/OR FIRE DEPARTMENT CONNECTION ARE LESS THAN 4 FEET FROM CURB LINE, OR WHEN OTHERWISE DETERMINED NECESSARY BY THE FIRE MARSHAL OR WATER DEPARTMENT.
- 2. ONLY GROUND COVER LANDSCAPING SHALL BE PLANTED WITHIN DIMENSIONED AREAS.
- 3. A 4'-0" MINIMUM AREA SHALL BE FREE FROM PLANTS OR SHRUBS OR OTHER OBSTRUCTIONS.
- 4. A 8'-0" MINIMUM AREA SHALL BE FREE FROM TREES.

APPROVED: SCOTT THOMASSON

REV. DATE: FEB. 1, 1997

WATERWASTEWATER DIVISION





STANDARD DETAILS

FIRE HYDRANT AND STANDPIPE LOCATION

FILE WTDT712.DGN DRAWING NO. 712